



ENERG
енергия · ενεργεια



Thermia


Atec 6



A+



B



2019

811/2013

Thermia

Atec 6




A+

55 °C

A+

35 °C

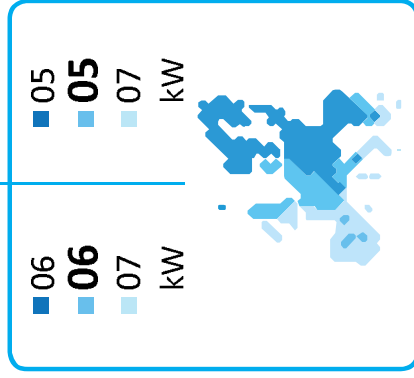

2019

811/2013

Thermia

Atec 6



A+



B



+



+



+



+



A+



B

2015

811/2013



ENERG
енергия · ενεργεια

ENERG
енергия · ενεργεια

Y IJA
IE IA

Thermia


Atec 9



A++



A

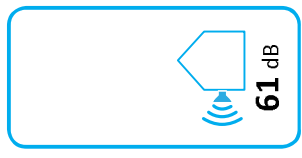

2019

811/2013

Thermia

Atec 9





A++

55 °C

A+

35 °C

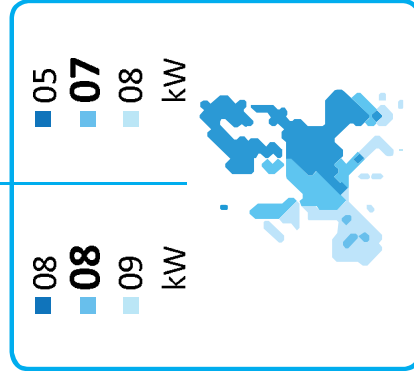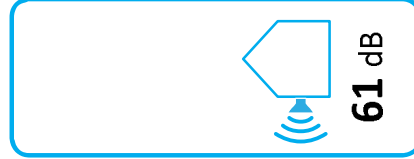

2019

811/2013

Thermia

Atec 9



A++

A



+




+




+



+

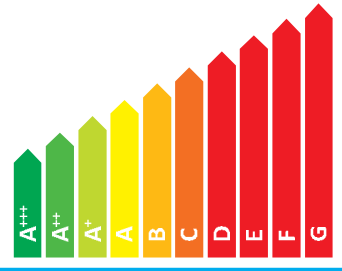

A++

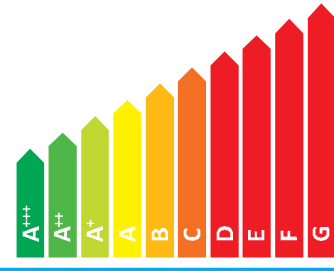

A

2015

811/2013




ENERG
енергия · ενεργεια




Thermia

Atec 11

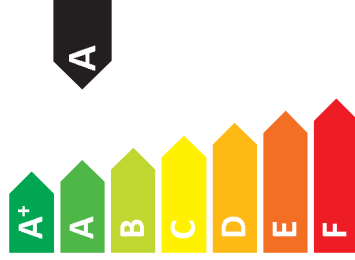

A+

A



2019

811/2013



ENERG
енергия · ενεργεια



Thermia

Atec 11





55 °C

A+

35 °C

A++

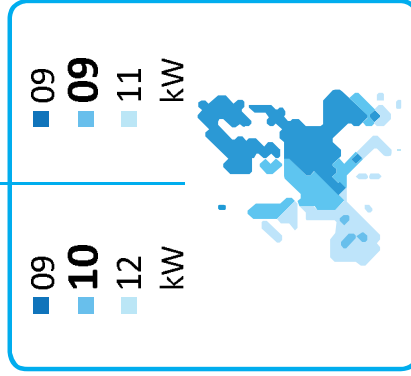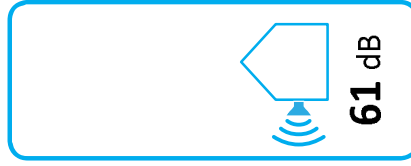

2019

811/2013

ENERG
енергия · ενεργεια



Thermia

Atec 11



A+

A



+



+



+



+



A

2015

811/2013




ENERG
енергия · ενεργεια





Thermia

Atec 13

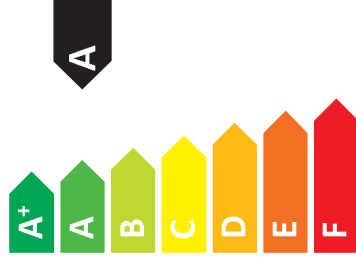

A++

A+



2019

811/2013




ENERG
енергия · ενεργεια



Thermia

Atec 13

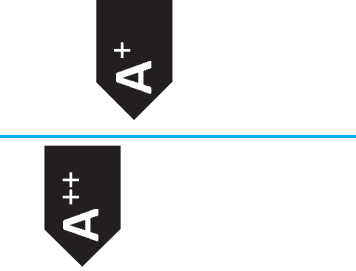


55 °C

35 °C

A++


A+

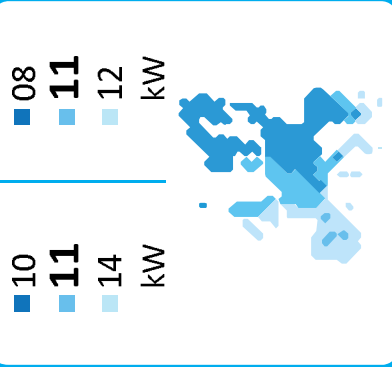

2019

811/2013

ENERG
енергия · ενεργεια



Thermia

Atec 13



+




+



+



+

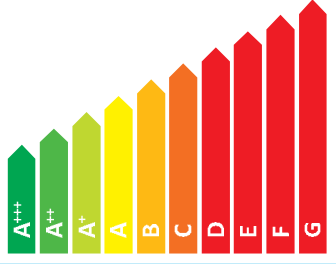

A++



A

2015

811/2013



ENERG
енергия · ενεργεια

ENERG
енергия · ενεργεια

Y IJA
IE IA

Thermia


Atec 16



A+



B

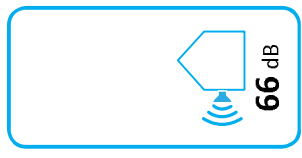

2019

811/2013

Thermia

Atec 16




55 °C



A+

35 °C

A++

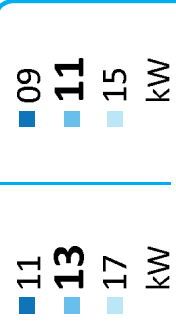

2019

811/2013

Thermia

Atec 16



A+



B

XL



+




+




+



+

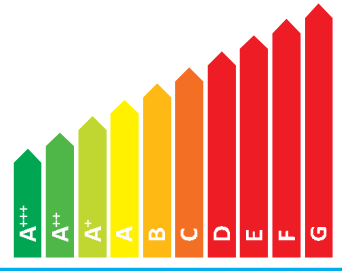

A+

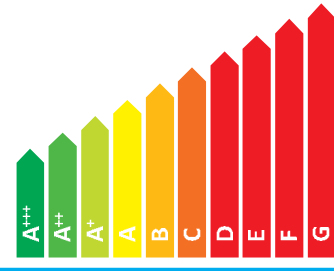


B

2015

811/2013



ENERG
енергия · ενεργεια



Thermia



Atec 18



A+



B

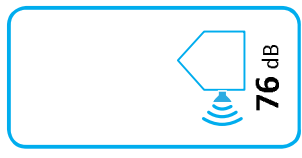


2019

811/2013



ENERG
енергия · ενεργεια



Thermia

Atec 18



55 °C




A+

35 °C




A+

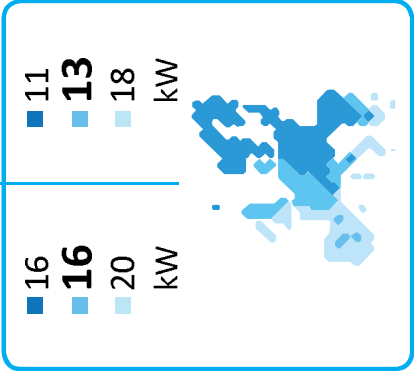

2019

811/2013

ENERG
енергия · ενεργεια




Thermia

Atec 18



A+


B

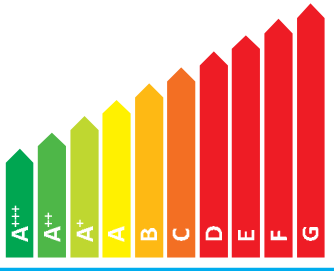

A+



B

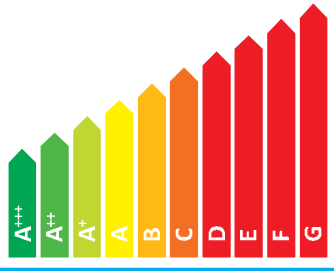

B



+



+



+



+



2015

811/2013



ENERG
енергия · ενεργεια



Thermia

Atec 6 SP



A+



B

61 dB

06 kW
06 kW
07 kW



2019

811/2013

Thermia

Atec 6 SP



55 °C



A+

35 °C



A+

61 dB

06 kW
06 kW
07 kW

05 kW
05 kW
07 kW



2019

811/2013

Thermia

Atec 6 SP



A+



B



+




+



+



+

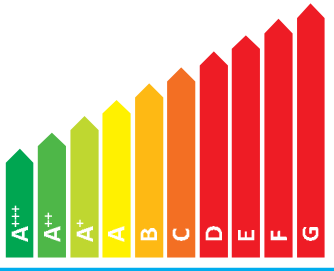

A+



XL



B

2015

811/2013





ENERG
енергия · ενεργεια



Thermia Atec 9 SP

Thermia

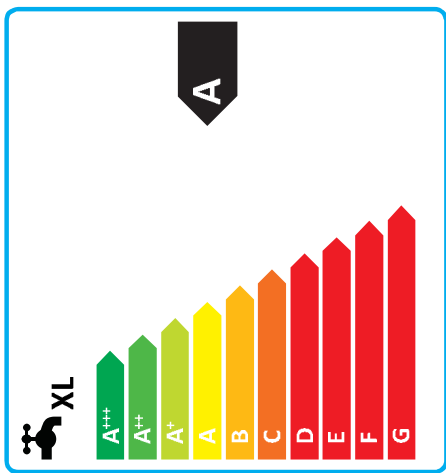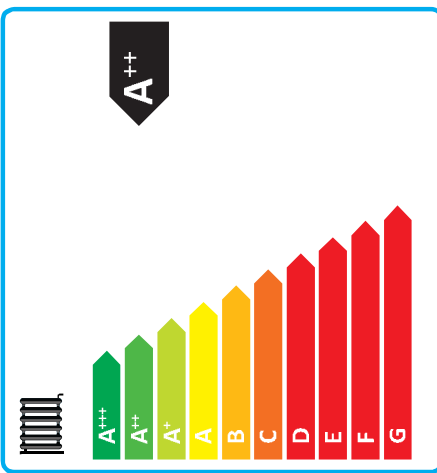


2015

811/2013



ENERG
енергия · ενεργεια



Thermia

Atec 9 SP



35 °C

55 °C



A+++ **A++** **A+** **A** **B** **C** **D**

61 dB


■ 08 ■ 09 kW
 ■ 05 ■ 07 ■ 08 kW

2019

811/2013



ENERG
енергия · ενεργεια



Thermia

Atec 9 SP



A+++ **A++** **A+** **A** **B** **C** **D**

61 dB


■ 08 kW ■ 09 kW
 ■ 08 kW

2019

811/2013



ENERG
енергия · ενεργεια



Thermia

Atec 11 SP



A+



A



2019

811/2013

Thermia

Atec 11 SP





55 °C



A+

35 °C

A++

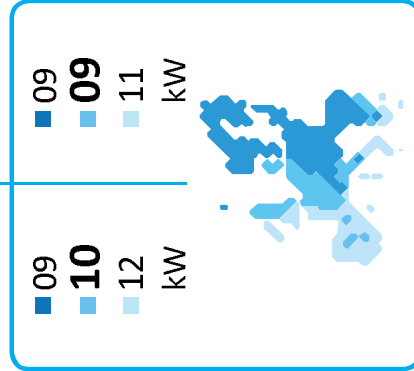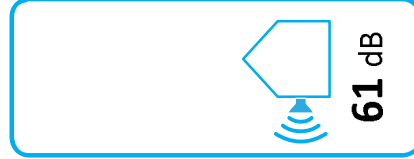

2019

811/2013

Thermia

Atec 11 SP



A+



+




+




+



+

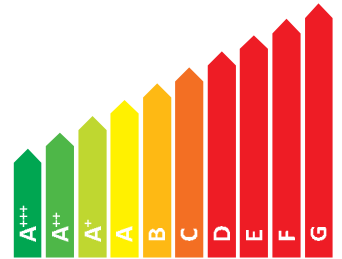

A+

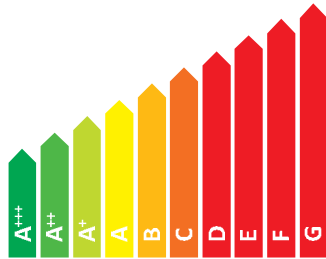

A

2015

811/2013



ENERG
енергия · ενεργεια

ENERG
енергия · ενεργεια

Y IJA
IE IA

Thermia


Atec 13 SP



A++



A



2019

811/2013

Thermia

Atec 13 SP




55 °C



A++

35 °C

A+

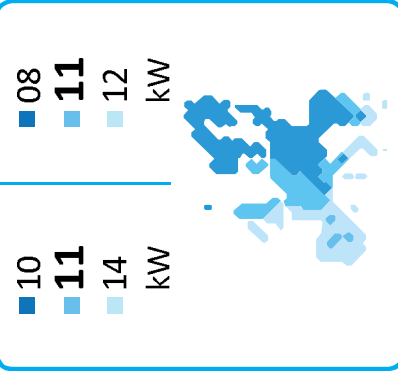

2019

811/2013

Thermia

Atec 13 SP



A++

A



+



+




+



+



A++

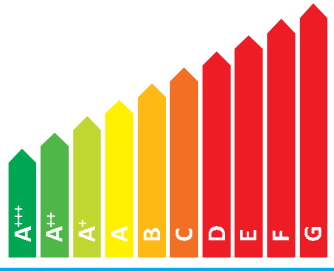

A

2015

811/2013



ENERG
енергия · ενεργεια



Thermia


Atec 16 SP



A+



B

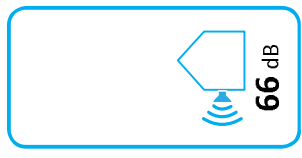

2019

811/2013



ENERG
енергия · ενεργεια



Thermia

Atec 16 SP




55 °C



A+

35 °C

A++

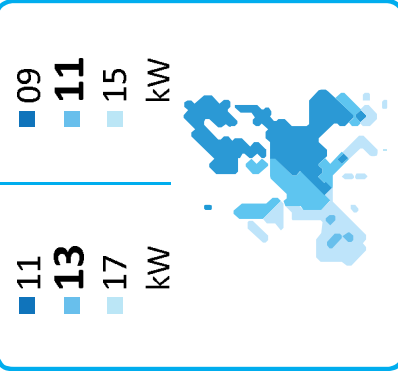

2019

811/2013

ENERG
енергия · ενεργεια



Thermia

Atec 16 SP



A+



B



+




+



+



+

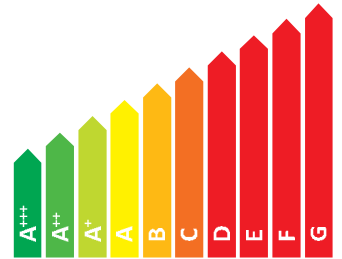

A+



B

2015

811/2013